


Permit Reference Number : EPR / TP3836CT

Operator : Viridor

Installation: Beddington

Form Number: AIR 2 / 23/07/13 [A2]

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of July 2024

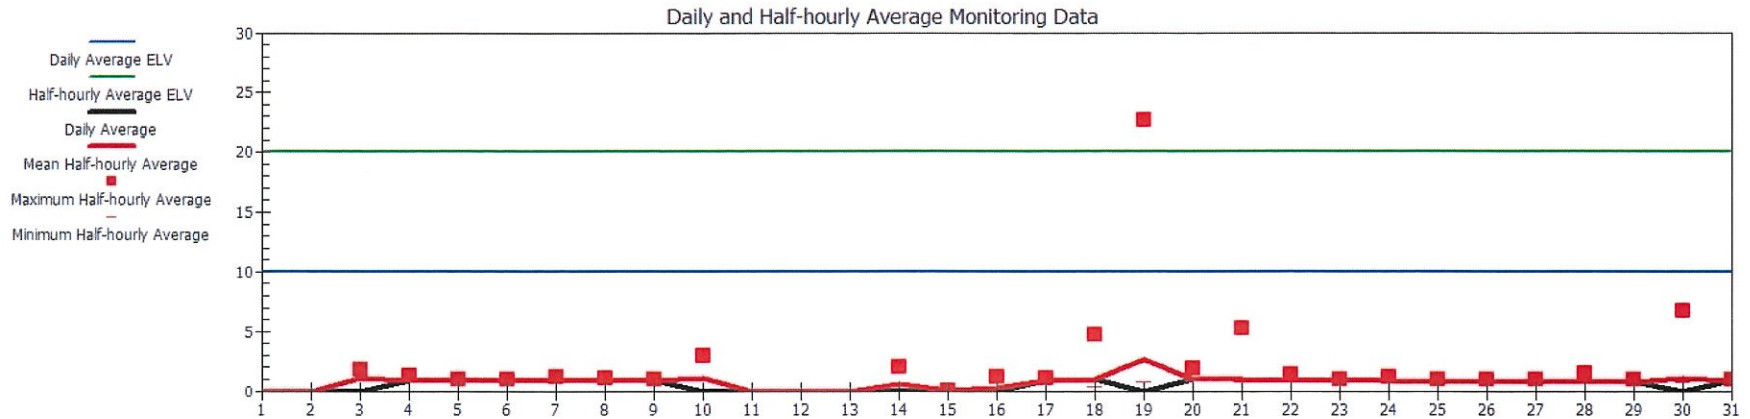

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	
	Monthly maximum	22.6	Maximum Half-hourly average	Off	Off	1.8	1.3	1.0	1.0	1.2	1.1	1.0	3.0	Off	Off	Off	2.0	0.1	1.2	1.1	4.7	22.6	1.9	5.3	1.4	1.0	1.2	1.0	1.0	1.0	1.5	1.0	6.8	1.0	
	Monthly mean	0.9	Mean Half-hourly average	Off	Off	1.1	0.9	0.9	0.9	0.9	0.9	0.9	1.1	Off	Off	Off	0.6	0.0	0.2	0.9	1.0	2.6	1.0	0.9	0.9	0.8	0.9	0.8	0.8	0.8	0.8	0.8	1.1	0.8	
	Monthly minimum	0.0	Minimum Half-hourly average	Off	Off	0.9	0.9	0.9	0.8	0.9	0.9	0.9	0.9	Off	Off	Off	0.0	0.0	0.0	0.8	0.4	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.8	0.7	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	1	No of exceedances of ELV	Off	Off	0	0	0	0	0	0	0	0	Off	Off	Off	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Monthly maximum	1.0	Daily average	Off	Off	N/A	0.9	0.9	0.9	0.9	0.9	0.9	N/A	Off	Off	Off	N/A	N/A	N/A	0.9	1.0	N/A	1.0	0.9	0.9	0.8	0.9	0.8	0.8	0.8	0.8	0.8	0.8	N/A	0.8
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....*D. Indeslić*.....
 (Authorised to sign as a representative of the Operator)

Date.....*2.08.2024*.....