


Permit Reference Number : EPR / TP3836CT

Operator : Viridor

Installation: Beddington

Form Number: AIR 2 / 23/07/13 [A2]

Reporting of Continuously Monitored Emissions to Air for VOC mg/m3 at Emission Point A2 For the month of August 2024

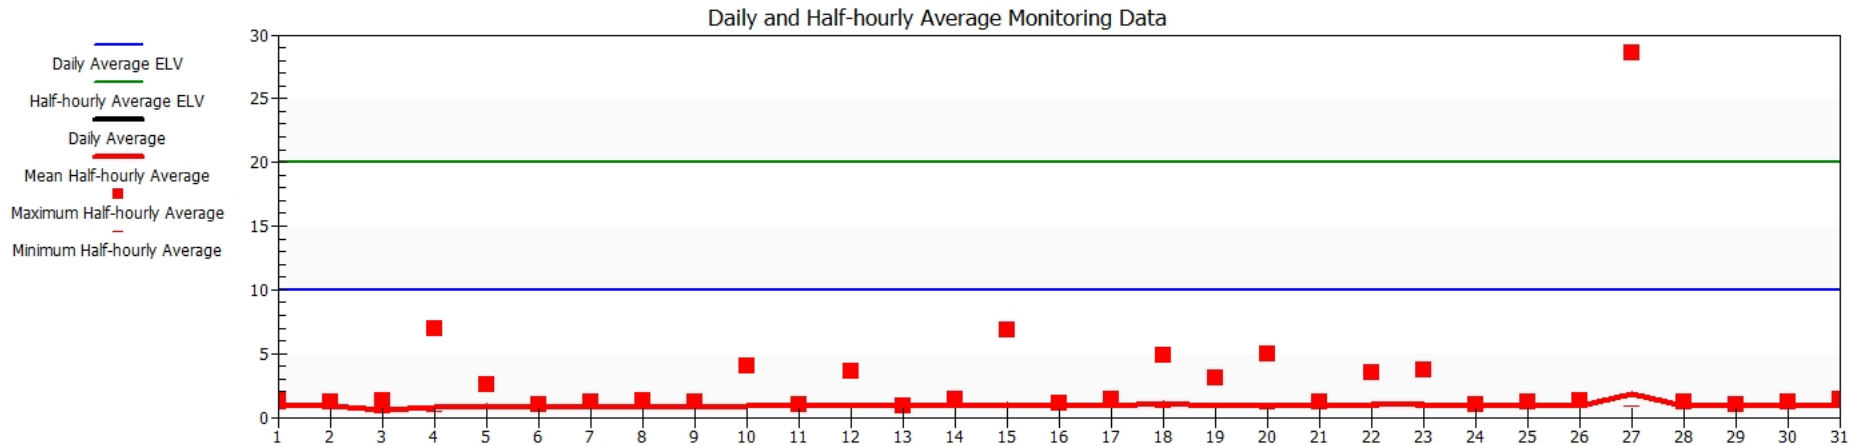

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0		
	Monthly maximum	28.6	Maximum Half-hourly average	1.3	1.2	1.3	7.0	2.6	1.0	1.2	1.3	1.2	4.0	1.0	3.6	0.9	1.4	6.8	1.1	1.5	4.8	3.1	4.9	1.2	3.5	3.7	1.0	1.2	1.3	28.6	1.2	1.0	1.2	1.4	
	Monthly mean	0.9	Mean Half-hourly average	0.9	0.9	0.6	0.8	0.8	0.8	0.8	0.8	0.8	0.9	0.8	0.9	0.8	0.8	1.0	0.9	0.9	1.1	0.9	0.9	0.9	0.9	1.0	0.9	0.9	0.9	1.8	0.9	0.9	0.9	0.9	
	Monthly minimum	0.3	Minimum Half-hourly average	0.7	0.8	0.3	0.5	0.7	0.8	0.8	0.8	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	1	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0
Daily average		Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Monthly maximum	1.8	Daily average	0.9	0.9	0.6	0.8	0.8	0.8	0.8	0.8	0.8	0.9	0.8	0.9	0.8	0.8	1.0	0.9	0.9	1.1	0.9	0.9	0.9	0.9	1.0	0.9	0.9	0.9	1.8	0.9	0.9	0.9	0.9	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed EQ

Date 02/09/2024

(Authorised to sign as a representative of the Operator)